



Top View

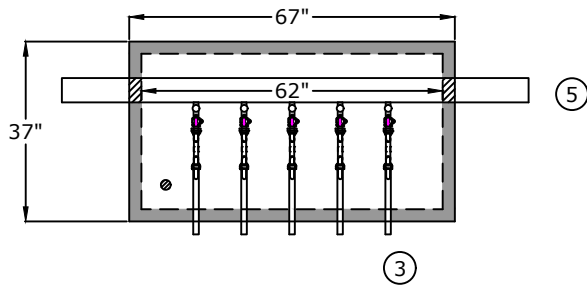


1. Meter Yoke
Ford 1" VBHH74-10W-81-44-NL
2. Corporation Stop
Ford 1" BALL CORP CCXFIP NO LEAD
FB 1600-NL
3. 1" x 18" Brass Nipple
4. 29" x 59" opening single leaf
aluminum door, pedestrian rated (300
lb/ft²) S1R02905C---D----
5. 4" Class 56 D.I.P.
6. 2" Drain Hole


Side View

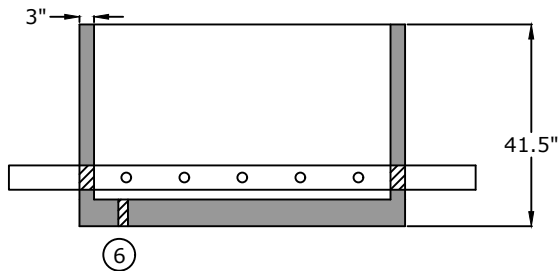


End View



Component Detail

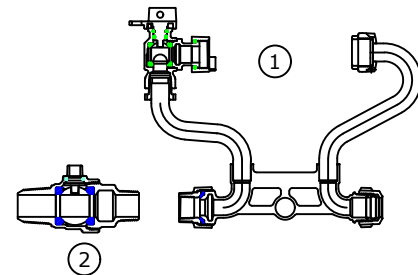

Pipe detail for taps

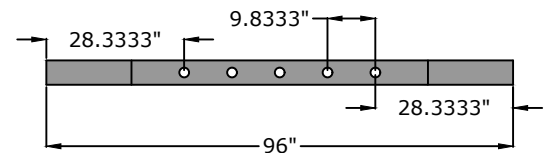

Approved for Production

Project: _____

Date: _____

Quantity: _____

By: _____

BARGER PRECAST

C.R. Barger & Sons, Inc.
P.O. Box 370 - Kingston TN 37763
Phone 888.882.5860 - BargerAndSons.com

Specifications

Concrete: 5,000 psi minimum strength (28 day)
Pipe Penetrations: All pipe penetrations are placed according to job requirements.
Pipe Stands: N/A
Sealant: N/A
Steps: N/A

5 Gang 1" Meter Vault Woodlawn Utility District

Date: 2.122025

Drawn By: Samantha Lowe

Approx. Empty Weight: 3,100 lbs.