




Top View

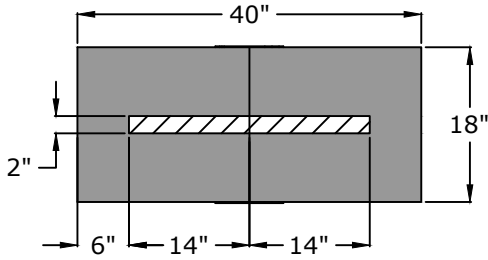

Side View



End View



Approved for Production

Project: _____

Date: _____

Quantity: _____

By: _____

Drawn by: Eric Barger **Date:** 8.082024

Specifications

Concrete: 4,000 psi minimum strength (28 day)
Reinforcing: Primary reinforcement will be a #3 rebar (Grade 60) rebar.
Pipe Penetrations: The inlet and outlet are fitted with open slots.
Sealant: Sealant used will meet or exceed ASTM C990.

**BARGER
 PRECAST**

P.O. Box 370 - Kingston TN 37763
 Phone 888.882.5860 - BargerPrecast.com

**18" x 40" Backflow Mounting Pad
 2 - Piece**