


End View


Top View


Notes:

ASTM C 1613 Compliant 4" Inlet/Outlet (Standard) Three 4" Holes in Baffle Wall 2/3 - 1/3 Compartment Capacity





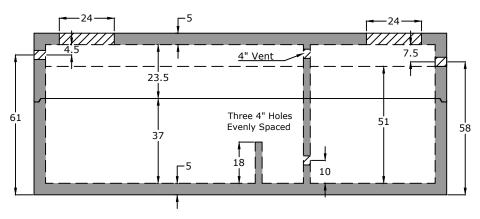



Side View

Baffle View

Specifications

Concrete: 5,000 psi minimum strength (28 day)
Reinforcing: Primary reinforcement will be rebar.
Risers: Grade rings and manhole frames and covers sold separately.

Research. Grader imps and infaminite traines and Covers Soid separately. Sealant: Sealant used in the seam of the tank will meet or exceed ASTM C990. Pipe Penetrations: Inlet and outlets are fitted with seals that meet or exceed all ASTM C923 specifications. Partition Wall: The partition wall, if present, is poured monolithically. Drawing: All measurements are accurate within ± 1 inch.

Tank Warranty: See Terms & Conditions.

Centroid(s): Lid (91, 39), Base (91, 39)

Weights

Top - 11,027 lb Bottom - 14,518 lb

Anti-Float Protection 25" of water

Installation: The tank hole is not to be more than 18 in. longer and wider than the tank. There shall be a minimum of 6" of 3/4" stone bedding. Do not install across path of vehicles or heavy equipment. This tank is designed for one hundred fifty pounds per square foot (150 lb/ft2) uniform loading on the top of the tank with a max backfill cover of 36" and a minimum of 6".

2,500 Gallon Grit Tank **Hamilton County WWTA - Hamilton County, TN** Date: 5.102010

P.O. Box 370 - Kingston TN 37763 Phone 888.882.5860 - BargerPrecast.com

Drawn By: Eric Barger

8.022024