

44.25 95.75 51.5


Top View


Notes:

ASTM C 1613 Compliant HS20 Traffic Rated 4" Inlet/Outlet (Standard) Three 4" Holes in Baffle Wall 2/3 - 1/3 Compartment Capacity ASTM C 990 Butyl Sealant

End View



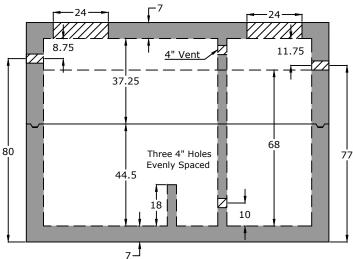



Side View

Baffle View

Specifications

Concrete: 5,000 psi minimum strength (28 day)
Reinforcing: Primary reinforcement will be rebar.
Risers: Grade rings and manhole frames and covers sold separately.
Sealant: Sealant used in the seam of the tank will meet or exceed ASTM C990.
Pipe Penetrations: Inlet and outlets are fitted with seals that meet or exceed all ASTM C923 specifications.
Partition Wall: The partition wall, if present, is poured monolithically.
Drawing: All measurements are accurate within ± 1 inch.

Tank Warranty: See Terms & Conditions.

Centroid(s): Lid (67, 36), Base (67, 36)

Weights

Top - 14,928 lb Bottom - 17,372 lb

Anti-Float Protection

3" of water

Installation: The tank hole is not to be more than 18 in. longer and wider than the tank. There shall be a minimum of 6" of 3/4" stone bedding. This tank is designed for HS20 traffic loads and with a max backfill cover of 8' and a minimum of 6".

P.O. Box 370 - Kingston TN 37763 Phone 888.882.5860 - BargerPrecast.com

2,000 Gallon HS20 Grit Tank **Hamilton County WWTA - Hamilton County, TN**

Date: 5.102010

Drawn By: Eric Barger

8.022024