


Top View

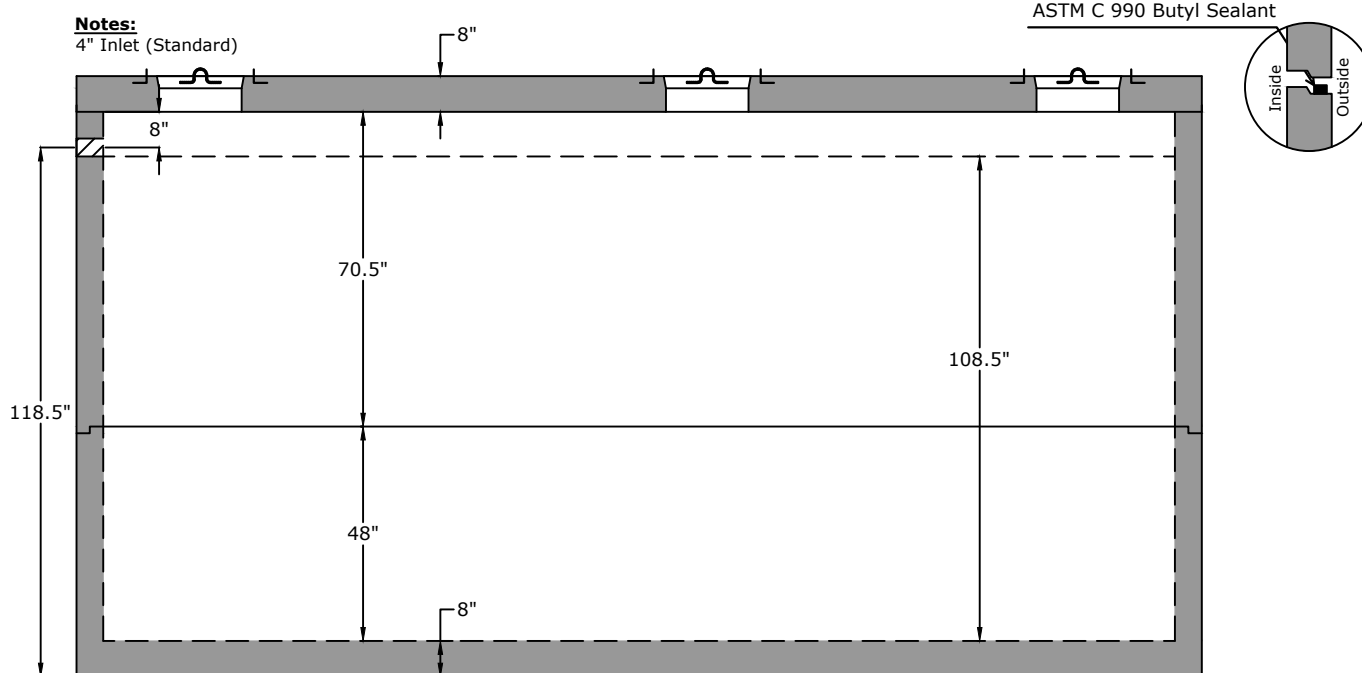

Side View

Specifications

Concrete: 5,000 psi minimum strength (28 day)
Reinforcing: Primary reinforcement will be rebar.
Risers: Grade rings and manhole frames and covers sold separately.
Sealant: Sealant used in the seam of the tank will meet or exceed ASTM C990.
Pipe Penetrations: Inlet and outlets are fitted with seals that meet or exceed all ASTM C923 specifications.
Drawing: All measurements are accurate within ± 1 inch.

Tank Warranty: See Terms & Conditions.

BARGER

PRECAST

P.O. Box 370 - Kingston TN 37763
 Phone 888.882.5860 - BargerAndSons.com

Weights

Top - 19,000 lb
 Riser - 26,000 lb
 Bottom - 36,000 lb

Anti-Float Protection

32" of water

Installation: The tank hole is not to be more than 18 in. longer and wider than the tank. There shall be a minimum of 6" of 3/4" stone bedding. Do not install across path of vehicles or heavy equipment. This tank is designed for one hundred fifty pounds per square foot (150 lb/ft²) uniform loading on the top of the tank with a max backfill cover of 36" and a minimum of 6".

11,000 Gallon Pump Tank

Date: 8.202019

Drawn By: Eric Barger

Updated: 8.162024