


Top View

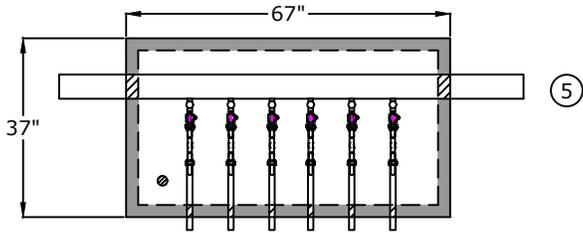


- 1. Meter Yoke
A.Y. McDonald 720-107 WWDD-33
Full Port Ball Valve
Full Port Ball Valve


Note: $\frac{3}{4}$ " x 6" Brass Nipple between 1 & 2

- 2. Corporation Stop
A.Y. McDonald 7410BCAPF
- 3. $\frac{3}{4}$ " x 18" Brass Nipple
- 4. 29" x 59" opening single leaf aluminum door, pedestrian rated (300 lb/ft²)
S1R029059B
- 5. 4" Class 53 D.I.P.
- 6. 2" drain hole


Side View

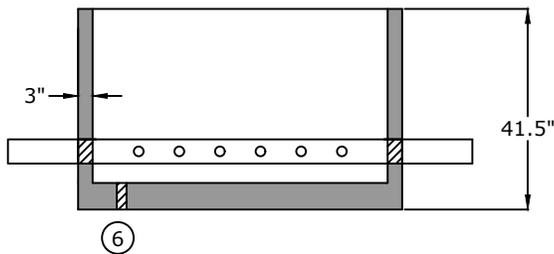


Component Detail

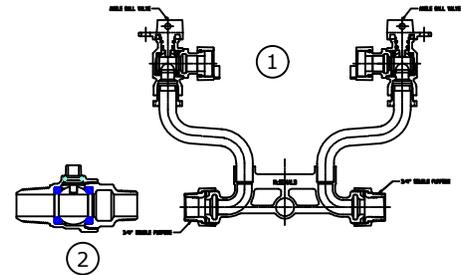

End View



Pipe detail for taps



Approved for Production

Project: _____ Date: _____

Quantity: _____ By: _____

BARGER PRECAST

Specifications

Concrete: 5,000 psi minimum strength (28 day)
Pipe Penetrations: All pipe penetrations are placed according to job requirements.

6-Gang $\frac{3}{4}$ " Meter Vault City of Martin

P.O. Box 370 - Kingston TN 37763
Phone 888.882.5860 - BargerPrecast.com

Date: 10.022024

Drawn By: Samantha Lowe

Approx. Vault Weight: 3,100 lbs.